


Vertical valves are shown for illustration.
Field conditions will determine the use of angled,
vertical, horizontal or any combination to complete the installation.



Notes:

1. Refer to City of Sanford drawing SD-R-003 for asphalt patch details if necessary.
2. Residential meters may be $\frac{3}{4}$ " or 1".
3. Piping shall be type 'K' copper with appropriate sized fittings.
4. Place washed stone under and around pipe to protect corporation stop.
5. Mueller or Ford brass valves, yoke fittings, and stops shall be provided.

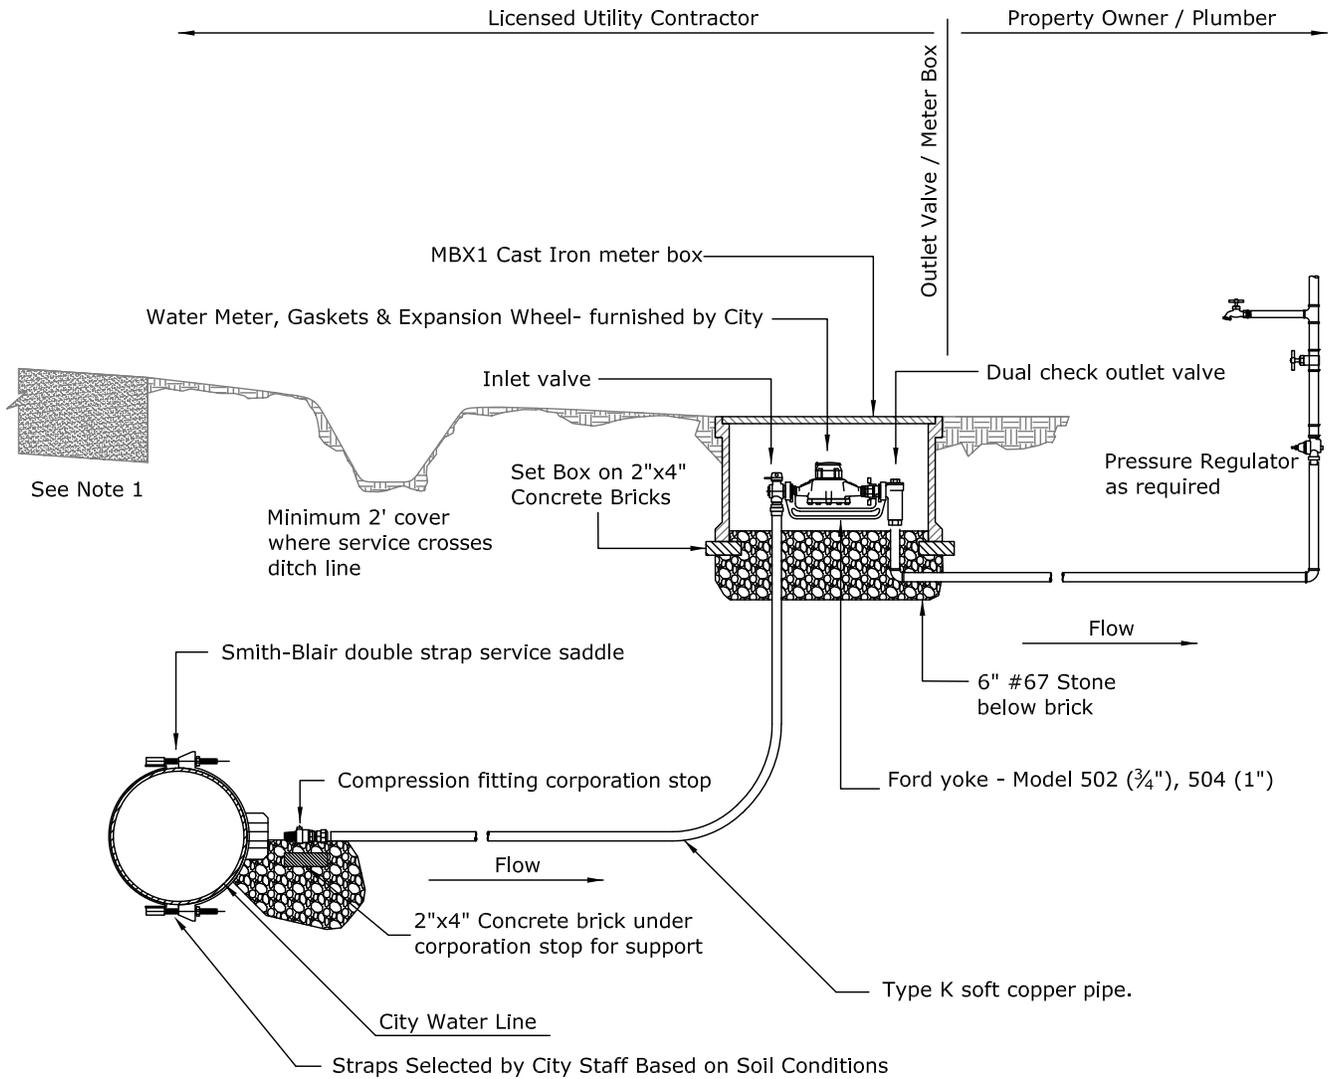

Residential Water Tap & Meter

City of Sanford Engineering Dept - P.O. Box 3729 - Sanford, NC 27331

Dwg. No. SD-W-001

Date: 02/11/20

Scale: Not To Scale

Drawn By: Staff