



Field conditions may dictate some variation in the geometry of the basic ramp types.


All ramps, warning plates etc. shall conform to the latest A.D.A. guidelines.

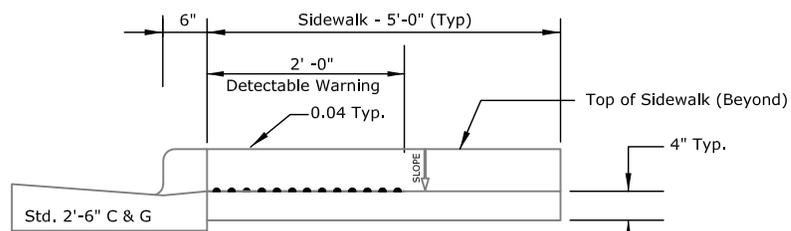

Typical Cross Section - Type 1 Ramps

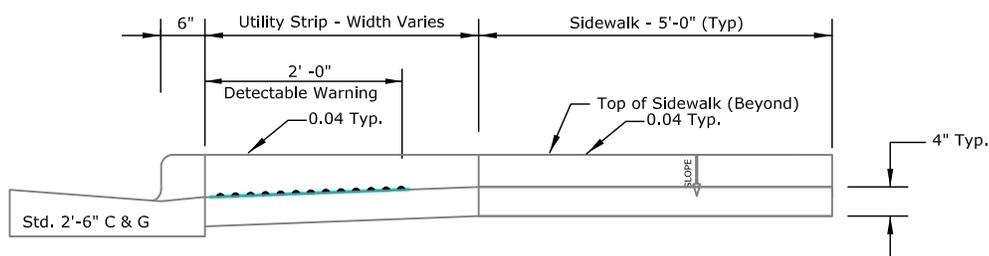

Typical Cross Section - Type 2 Ramps

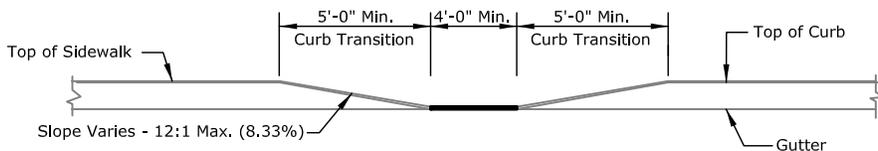

Typical Sidewalk Geometry - All Ramps

**GENERAL NOTES**

1. All work shall be in accordance with all applicable local, state and/or federal statutes, or regulations.
2. Place wheelchair ramps at locations designated on the drawings or as directed by the Engineer.
3. Plates with detectable warning surface shall be a minimum of 2' x 3'.
4. Ramp grades shall not exceed 12:1 (8.33%) in relation to the grade of the street.
5. Type B, C, D & E ramps shall be a minimum of 6" thick concrete.



# Typical Wheelchair Ramps

City of Sanford Engineering Dept - P.O. Box 3729 - Sanford, NC 27331

Dwg. No. SD-R-005

Date: 07/10/14

Scale: Not To Scale

Drawn By: Staff