


Vertical valves are shown for illustration.
 Field conditions will determine the use of angled, vertical, horizontal or any combination to complete the installation.



Notes:

1. Refer to City of Sanford drawing SD-R-0013 for asphalt patch details if necessary.
2. Residential meters may be 3/4" or 1".
3. Piping shall be type 'K' copper with appropriate sized fittings.

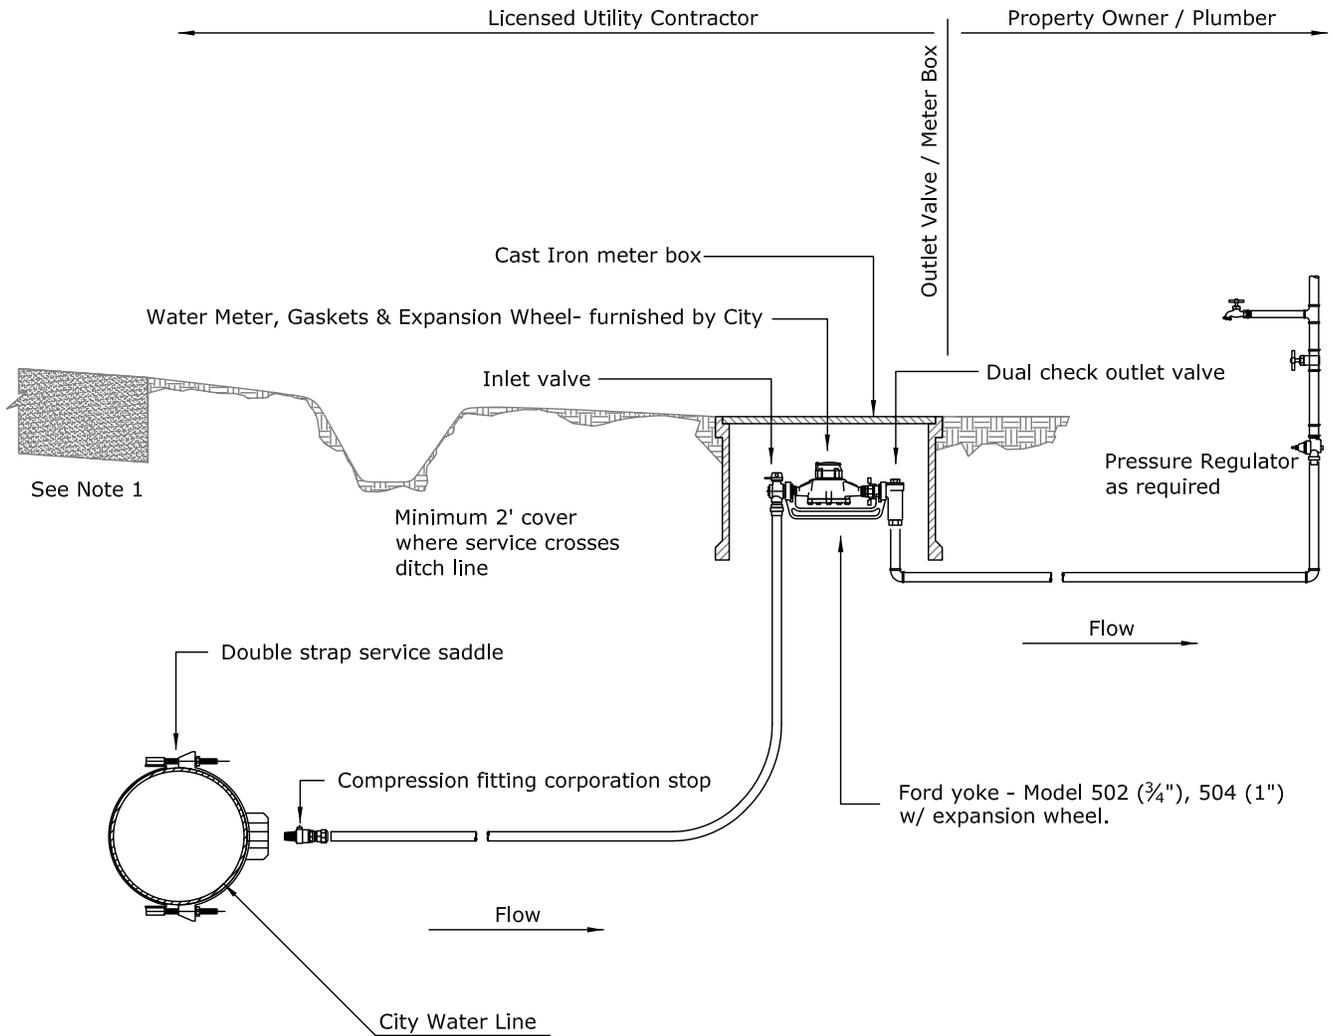

Residential Water Tap & Meter

City of Sanford Engineering Dept - P.O. Box 3729 - Sanford, NC 27331

Dwg. No. SD-W-001

Date: 07/10/14

Scale: Not To Scale

Drawn By: Staff