


Fire Hydrant:  
Refer to City of Sanford specifications for acceptable makes & models.



Notes:

1. Refer to City of Sanford drawing SD-R-003 for asphalt patch details if necessary.
2. Entire hydrant leg shall have minimum of 3'-0" cover. Ductile Iron CI 50 shall otherwise be used.
3. Within the city limits of Sanford or within the Northview Fire District, the 2½" nozzles shall have City of Sanford threads (3.112" x 8 threads per inch). All other locations shall be National Standard Thread.
4. Restrained Joints required throughout fire hydrant assembly.

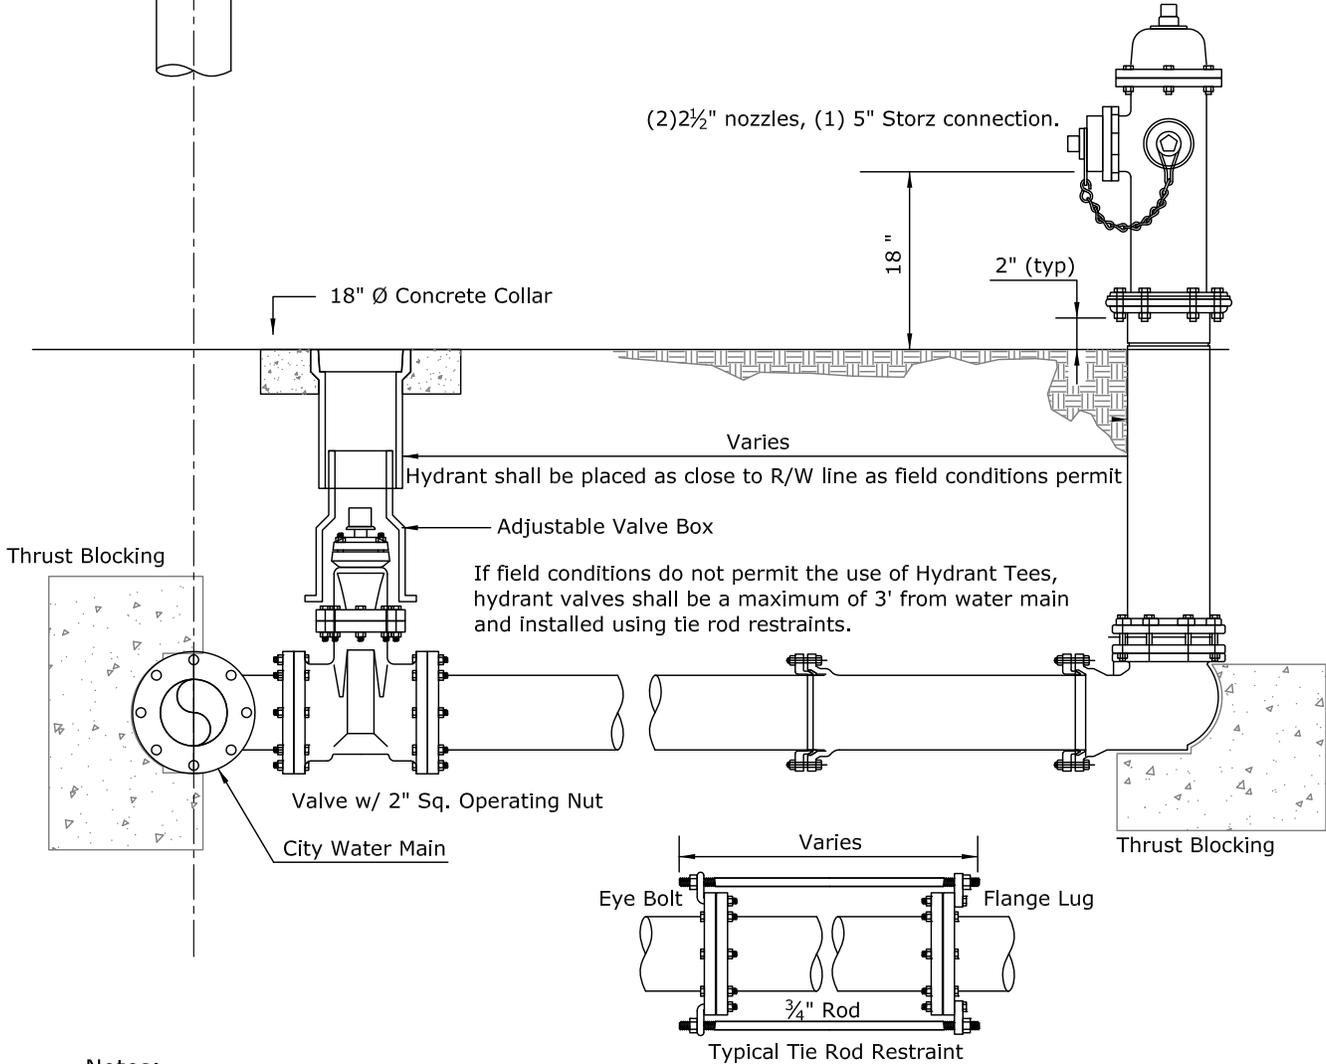

# Fire Hydrant Assembly

City of Sanford Engineering Dept - P.O. Box 3729 - Sanford, NC 27331

Dwg. No. SD-W-009

Date: 07/10/14

Scale: Not To Scale

Drawn By: Staff